


Figure 3

**FDA Recommendations for Quarantine and Disposition of Prior Collections,
Supplemental Testing, and Notification of Consignees and Transfusion Recipients
Based on EIA 1.0 Donor Test Results for Antibody to Hepatitis C Virus (Anti-HCV)**

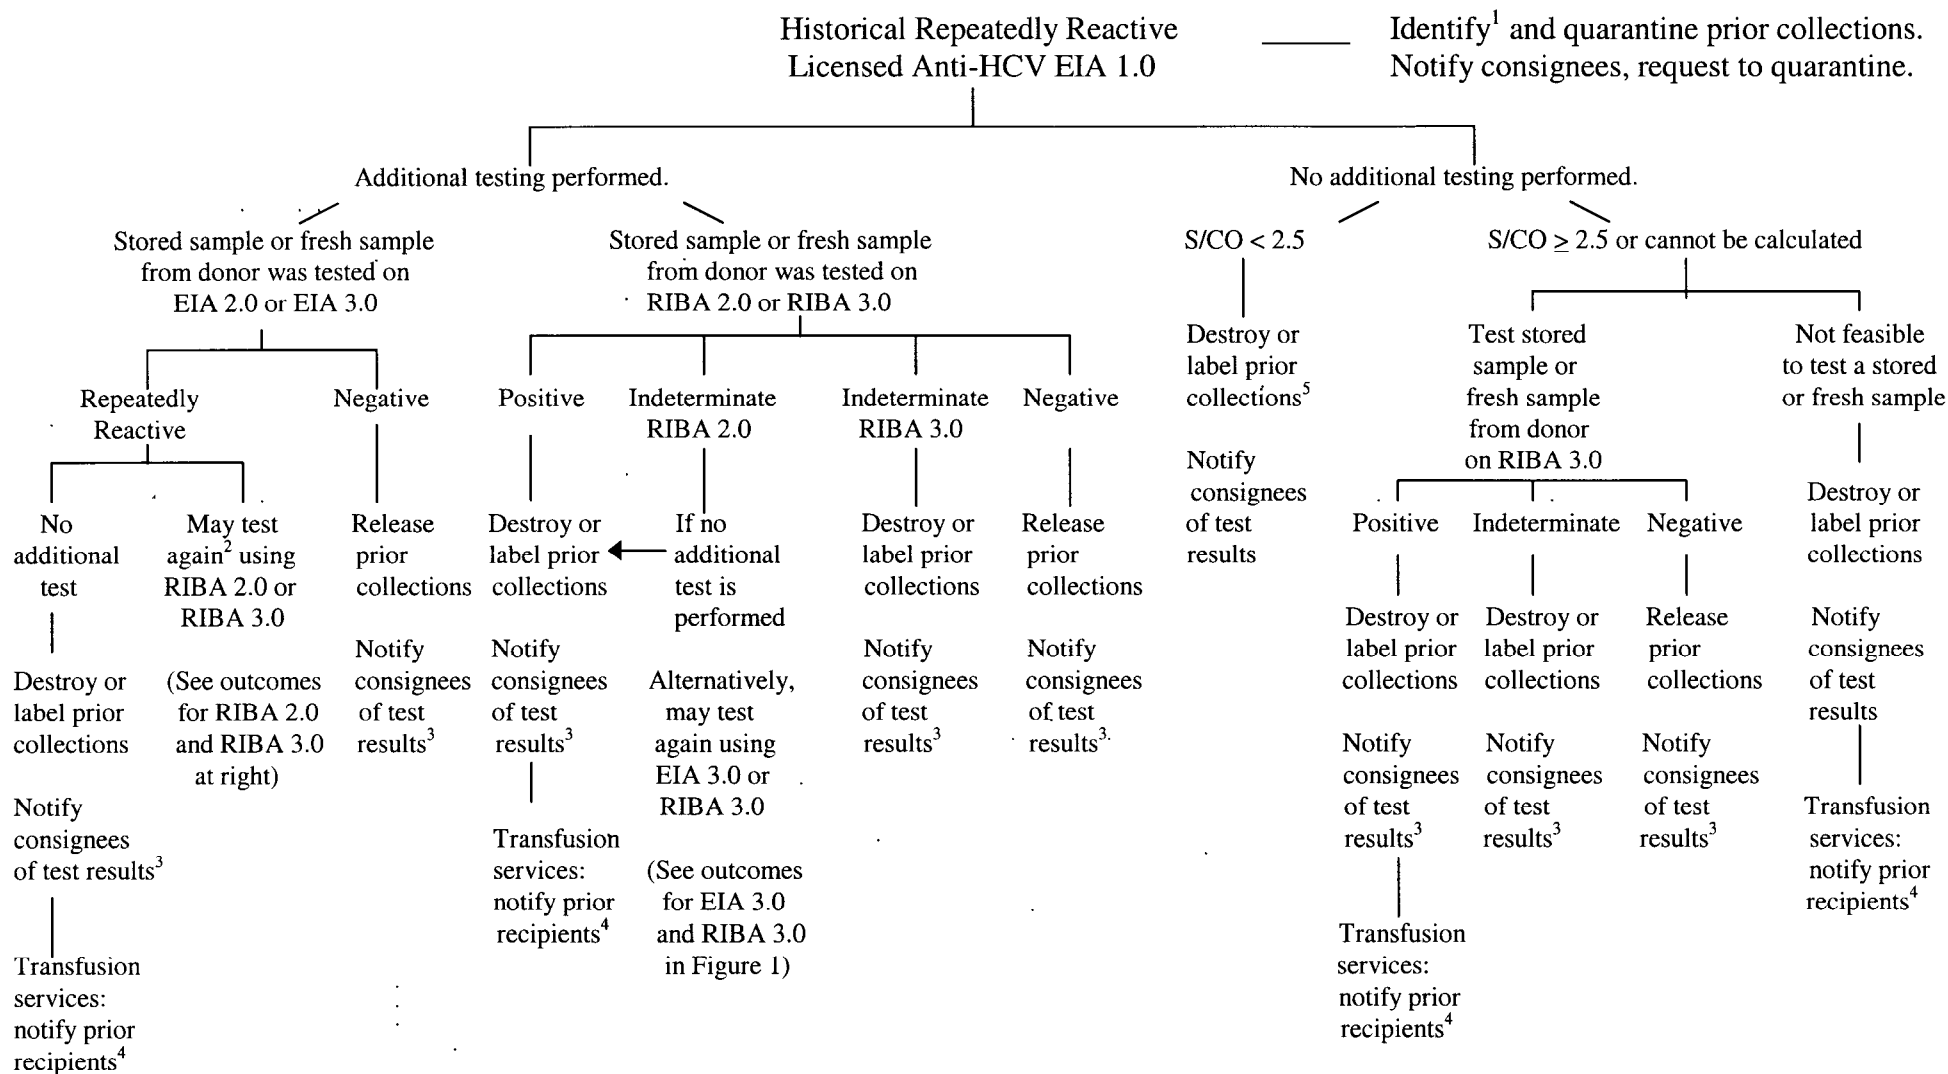

¹ Previously distributed prior collections should be identified from the same donor dating back indefinitely to the extent that electronic or other readily retrievable records exist.

² The supplemental test performed should include all the antigens contained in the screening test that was performed.

³ Notify consignees as soon as feasible after obtaining the additional test result.

⁴ Transfusion services should identify and notify recipients of prior collections dating back indefinitely.

⁵ Alternatively, additional testing may still be performed to determine the possibility for product release from quarantine.